



Recorder



Flow



Pressure



Temp



Analyzer



Level

Datasheet

Radar level meter

SIN-RD905

Sinomeasure

Committed to process automation solutions

Tel: 86-13336194863

E-mail: info@sinomeasure.com

www.sino-measure.com

Datasheet**Radar level meter
SIN-RD905**

This series of radar level meter adopted 26G high frequency radar sensor, the maximum measurement range can reach up to 80 meters. Antenna is optimized further processing, the new fast microprocessors have higher speed and efficiency can be done signal analysis, the instrumentation can be used for reactor, solid silo and very complex measurement environment.

Application

- Solid
- particles,
- Powder


Features

- Measuring Range: 30 meters
- Process Connection: Thread,
- FlangeMedium Temperature: -40℃ ~ 250℃
- Process Pressure : -0.1 ~ 4.0MPa (Flat flange)-0.1 ~ 0.1MPa (Universal Flange)
- Accuracy: $\pm 10\text{mm}$
- Protection Grade: IP67
- Frequency Range: 26GHz
- Signal Output: 4... 20mA/HART (Two-wire / Four)RS485/ Modbus

**Radar level meter**

Principle

Radar level transmitter antenna microwave pulse is narrow, the downward transmission antenna. Microwave exposure to the medium surface is reflected back again by the antenna system receives, sends the signal to the electronic circuit automatically converted into level signals (because the microwave propagation speed, electromagnetic wave to reach the target and the reflected back to the receiver this time is almost instantaneous).

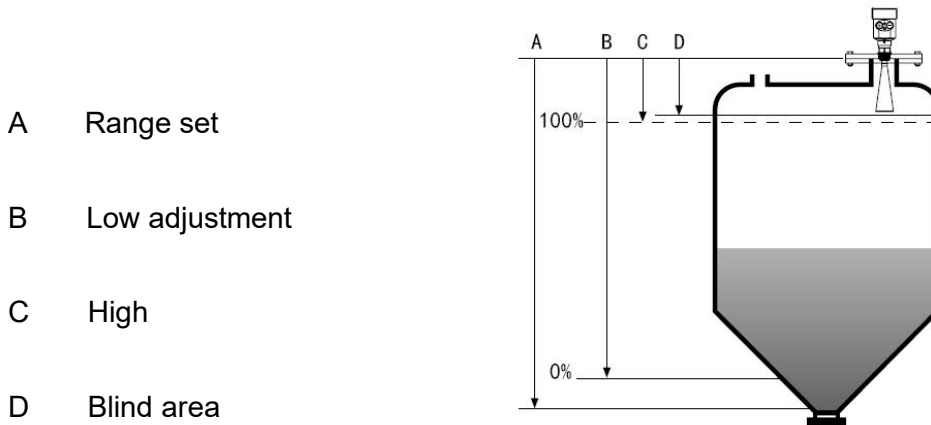

Datum measurement: Screw thread bottom or the sealing surface of the flange.

Note: Make sure the radar level meter the highest level cannot enter the measuring blind area (Figure D shown below).

The characteristics of 26G radar level meter:

- Small antenna size, easy to install; Non-contact radar, no wear, no pollution.
- Almost no corrosion, bubble effect; almost not affected by water vapor in the atmosphere, the temperature and pressure changes.
- Serious dust environment on the high level meter work has little effect.
- A shorter wavelength, the reflection of solid surface inclination is better.
- Beam angle is small, the energy is concentrated, can enhance the ability of echo and to avoid interference.
- The measuring range is smaller, for a measurement will yield good results.
- High signal-to-noise ratio, the level fluctuation state can obtain better performance.
- High frequency, measurement of solid and low dielectric constant of the best choice.

Parameters		
The outer shell		
The seal between the shell and the shell cover	Silicone rubber	
Casing window	Polycarbonate	
The ground terminal	Stainless steel	
The power supply voltage		
Two wire system		
The standard type	(16 ~ 26) V DC	
Intrinsically safe	(21.6 ~ 26.4) V DC	
Power dissipation	max 22.5mA / 1W	
Allowable ripple	<100Hz	(100~100K) Hz
	Uss<IV	Uss<I0mV
The cable parameters		
Cable entrance / plug	M20xl.5 cable entrance blind plug	
Terminal	Conductor cross section 2.5mm²	
Output parameters		
The output signal	(4 ~ 20) mA/RS485	
Communication protocol	HART	
Resolution	1.6μA	
Fault signal	Constant current output; 20. 5mA 22mA 3.9mA	
The integral time	(0 ~ 36) s, adjustable	
Others		
Blind area	the ends of the antenn a	
The maximum distance measurement	30 meters (for solids)	
Microwave frequency	26GHz	
Communication interface	HART communication protocol	
The measurement interval	about 1 second (depending on the parameter settings)	
Adjust the time	about 1 second (depending on the parameter settings)	
Display resolution	1 mm	
Working storage and transportation temperature	(-40~80) °C	
Process temperature	(-40 to 130)°C for standard model / (-40 to 230)°C for high-temperature model	
Pressure	Max.4MPa	
Seismic	Mechanical vibration I0m/s², (10 ~ 150) Hz	

Installation Requirements

Installation guide:

Be installed in the diameter of the 1/4 or 1/6.




Note: The minimum distance from the tank wall should be 200mm.

Note: ① datum
② The container center or axis of symmetry

- The top conical tank level, can be installed at the top of the tank is intermediate, can guarantee the measurement to the conical bottom.

- A feed antenna to the vertical alignment surface. If the surface is rough, stack angle must be used to adjust the angle of cardan flange of the antenna to the alignment surface.


(Due to the solid surface tilt will cause the echo attenuation, even Loss of signal.)

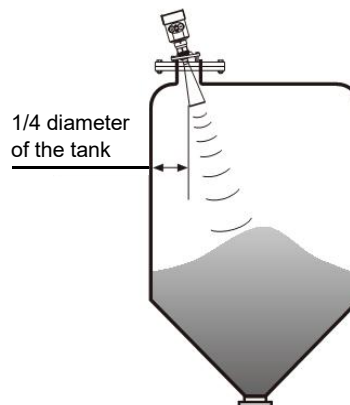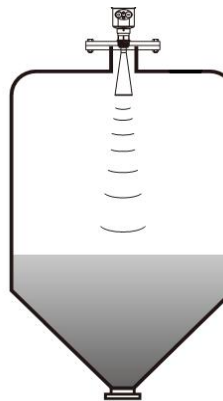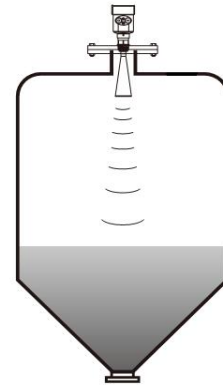


Typical installation errors:

- Conical tank cannot be installed above the feed port.

Note: outdoor installation should adopt sunshade.

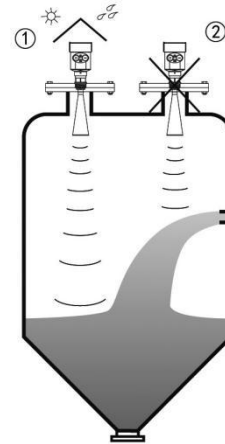


- The instrument cannot be installed in the arched or domed roof intermediate. In addition to produce indirect echo is also affected by the echoes. Multiple echo can be larger than the real value of signal echo, because through the top can concentrate multiple echo. So cannot be installed in a central location.

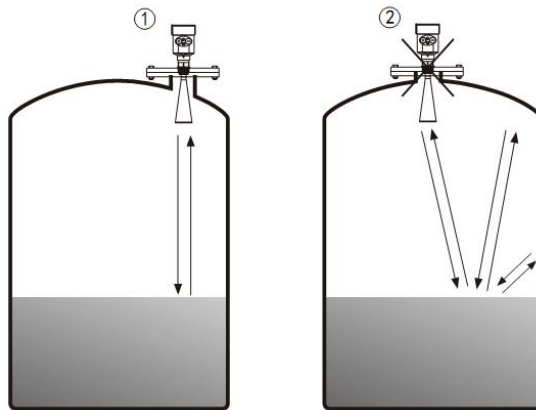

- ① Correct
- ② Error


- There are obstacles affecting measurement needed reflection plate.

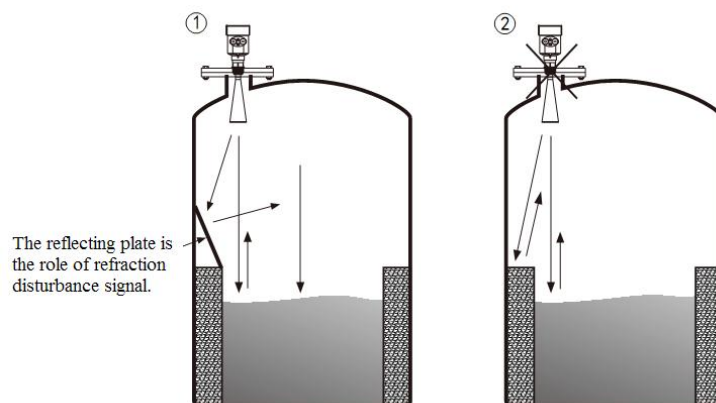

- ① Correct
- ② Error

■ Height of nozzle:

Antenna extends into the tank
at least 10mm distance.

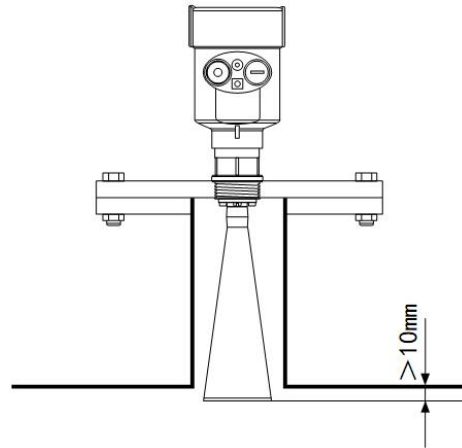


Electrical Connection

The power supply voltage:


(4~20)mA/HART (Two wire system)	The power supply and the output current signal sharing a two core shield cable. The supply voltage range see technical data. For intrinsically safe type must be a safety barrier between the power supply and the instrument.
(4~20)mA/HART(Four wire system)	Separate power supply and the current signal, respectively using a two-core shielded cable. The supply voltage range see technical data.
RS485 / Modbus	Power supply and Modbus signal line separated respectively using a two-core shielded cable, the power supply voltage range see technical data.

■ Connection mode:


- 24V two wire wiring diagram as follows:

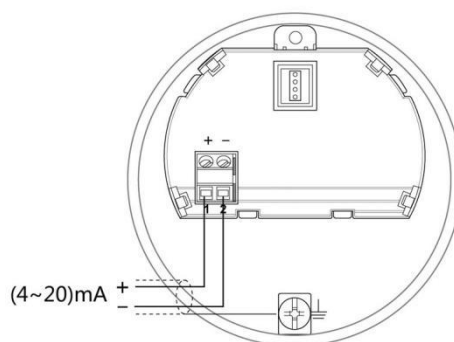

- 220V four wire connection is as below:

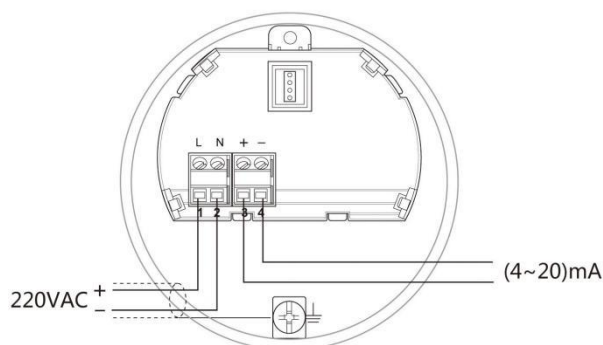

- 24V RS485/Modbus wiring diagram as follows:

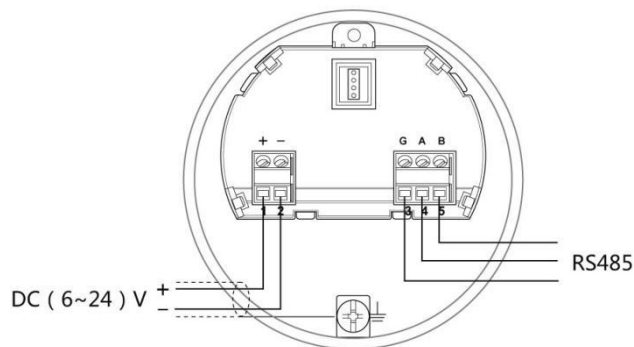


■ Safety instructions:

- Please observe the local electrical code requirements!
- Please comply with local requirements for personnel health and safety regulations.
All electrical components of instrument operation must be completed by the formal training of professionals.
- Please check the instrument nameplate to provide product specifications meet your requirements.
Please make sure that the power supply voltage and instrument nameplate on the requirements.

■ Protection grade:

This instrument meets the protection class IP66/67 requirements, please ensure the waterproof cable sealing head. The following diagram:

:

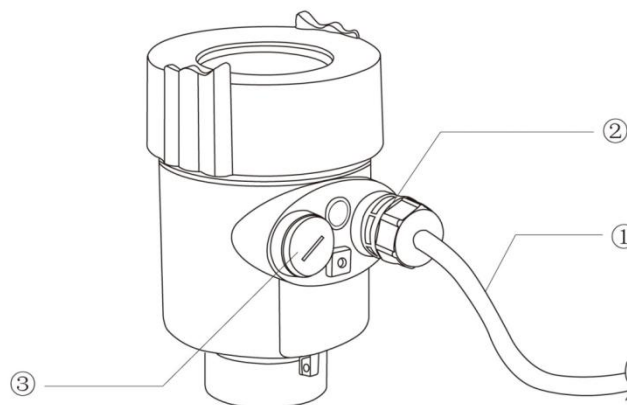

How to install to meet the requirements of IP67:

Please make sure that the sealing head is not damaged.

Please make sure that the cable is not damaged.

Please make sure that the cable for use with electrical connection specification.

Cable into the electrical interface before its curved downward, ensure that the water will not flow into the shell, see the ①

Tighten the cable seal head, see the ②

Please electrical interface will not use blind plug tight, see the ③

Instrument Commissioning


■ There are three kinds of debugging method:

- 1) Display / Keyboard
- 2) Host debugging
- 3) HART handheld programmer

■ Display / Keyboard:

Please debug the instrumentation by four buttons on the display screen. There are three debug menu languages optional. After debugging is generally used only for display, through the glass window can read measured value very clearly.

Display / Keyboard

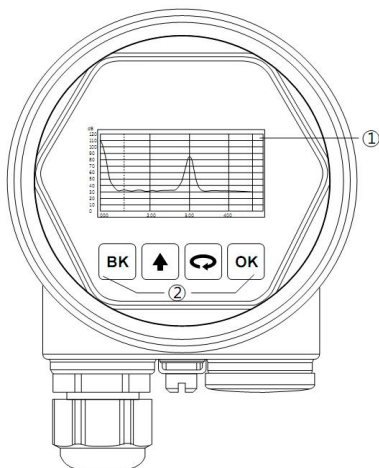


① Liquid crystal display(LCD)

② The key

■ PC debugging:


Connected to PC by HART

- ① RS232 interface or USB interface
- ② Radar level meter
- ③ HART adapter
- ④ 250 Ω resistor

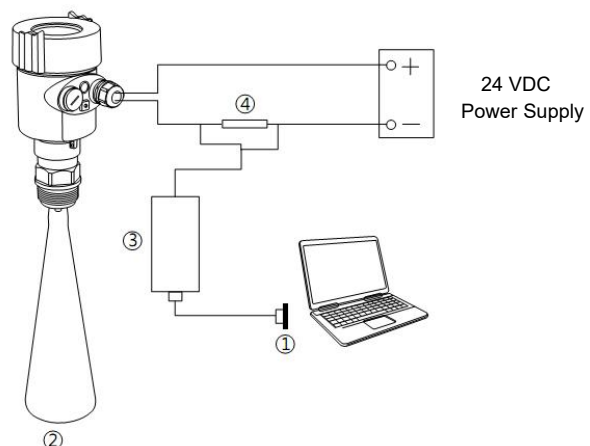

■ HART handheld programmer:


- ① HART handheld programmer
- ② Radar level meter
- ③ 250 Ω resistor

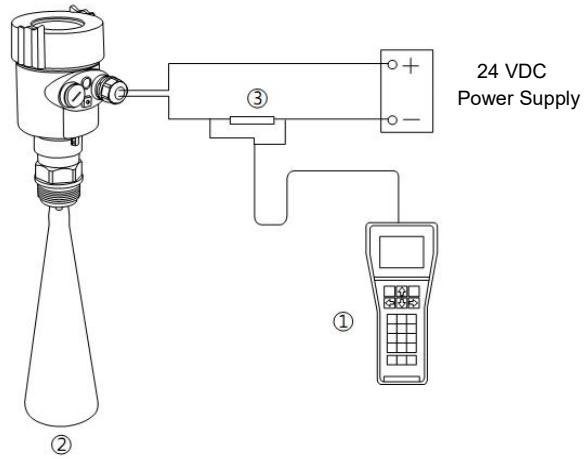


Structure Size

The outer shell :

SIN-RD905

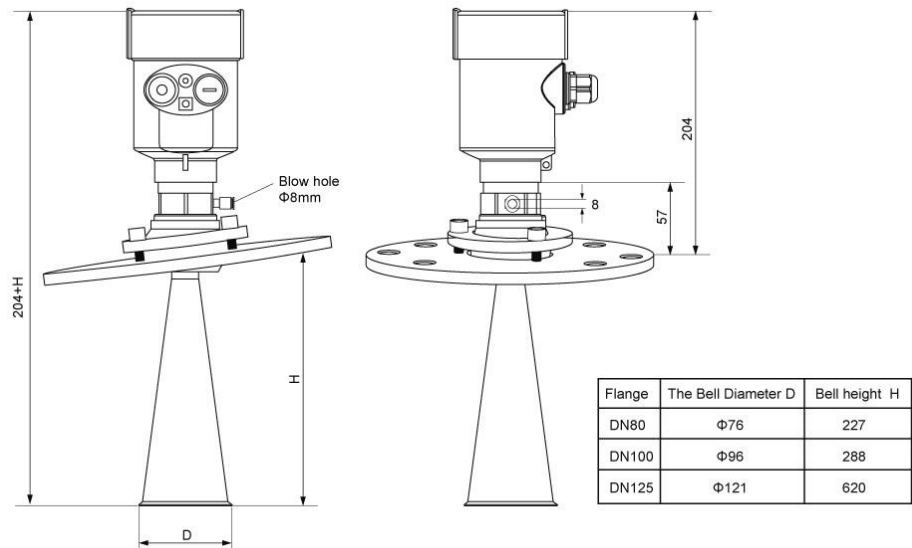


Flange type:

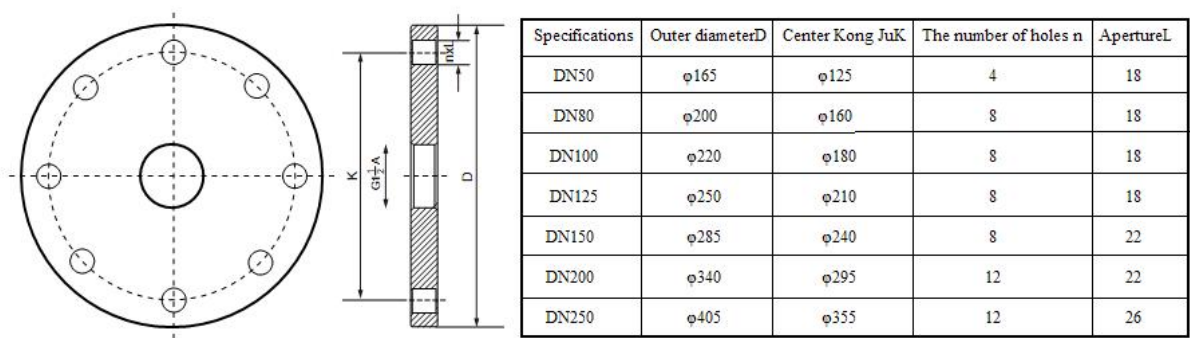

Meter Linearity

Emission angle	Depending on the size of the antenna
- $\varnothing$ 76mm	12°
- $\varnothing$ 96mm	8°
- $\varnothing$ 121mm	6°
Precision	See chart

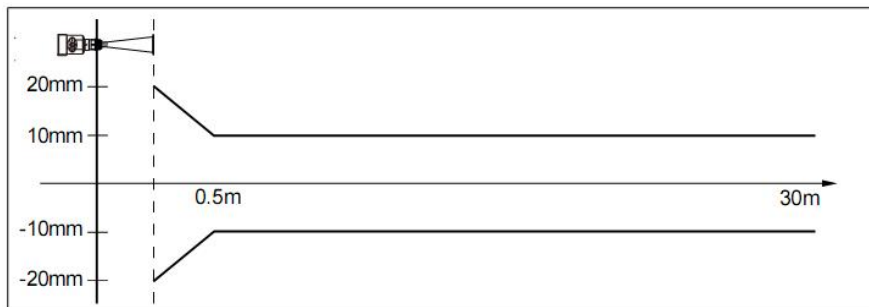

Model selection

Process Connection / Material

- G Thread G1½" A / Stainless Steel 304
- N Thread 1½" NPT / Stainless Steel 304
- B Flange DN80 / Stainless Steel 304
- C Flange DN100 / Stainless Steel 304
- D Flange DN125 / Stainless Steel 304
- E Flange DN150 / Stainless Steel 304
- M Flange DN80 / Cardan joint
- K Flange DN100 / Cardan joint
- T Flange DN125 / Cardan joint
- Y Special Custom

Antenna Type / Material

- B Horn Antenna Φ76mm / Stainless Steel 316L
- C Horn Antenna Φ96mm / Stainless Steel 316L
- D Horn Antenna Φ121mm / Stainless Steel 316L
- E Horn Antenna Φ76mm / Stainless Steel 316L / Blow hole
- F Horn Antenna Φ96mm / Stainless Steel 316L / Blow hole
- G Horn Antenna Φ121mm / Stainless Steel 316L / Blow hole
- H Horn Antenna Φ76mm / Stainless Steel 316L / Dust-proof Cover
- I Horn Antenna Φ96mm / Stainless Steel 316L / Dust-proof Cover
- J Horn Antenna Φ121mm / Stainless Steel 316L / Dust-proof Cover
- Y Special Custom

Seal Up / Process Temperature

- V Viton / (-40~150) °C
- K Kalrez / (-40~250) °C

The Electronic Unit

- 2 (4~20) mA / 24V DC / Two wire system
- 3 (4~20) mA / 24V DC / HART two wire system
- 4 (4~20) mA / 220V AC / Four wire system
- 5 RS485 / Modbus

Shell / Protection Grade

- L Aluminum / IP67
- G Plastic / IP65

Cable Line

- M M 20x1.5
- N ½" NPT

Field Display/The Programmer

- A Belt
- X Without

Company: _____ Contact: _____
Address: _____ Zip code: _____
The Telephone: _____ Fax: _____ Mobile phone: _____
E-mail: _____ Date: _____

Tank / Container Information

The Types of Tank:

☐ Tank ☐ Reaction Tank ☐ Separation Tank ☐ Marine Tank

The Tank Structure:

Material of Tank: _____ Pressure: _____

Tank size:

Tank Height: _____ m Diameter: _____

The top of the tank:

☐ Vault ☐ Flat ☐ Open ☐ Cone type

The bottom of the tank:

☐ Cone bottom ☐ Flat ☐ Slope bottom ☐ Arc bottom

Installation:

☐ Top installation ☐ Side installation
☐ The bypass pipe mount ☐ Guided wave pipe installation

Installation takes over the top of the tank (information):

Height of take over : _____ mm Diameter of take over : _____ mm

Measurement of Medium

Media name: ☐ Liquid ☐ Solid ☐ Mixed Media

Medium temperature: _____ °C

Dielectric Constant:

Linked material: ☐ Yes ☐ No

Mixing: ☐ Yes ☐ No

Process Connection

Thread: ☐ G1½" A ☐ 1½" NPT

Flange ☐ Flange (DN=) ☐ Flange (ANSI=)

Power supply:

☐ 24V DC Two wire system ☐ 24V DC Four wire system ☐ 220V AC Four wire system

Output: ☐ 4-20mA ☐ HART

Display: ☐ Take the meter display program ☐ Without meter display program

Ordering Code

Radar Level Transmitter SIN-RD905										Description
SIN-RD905	-	-	-	-	-	-	-	-	-	
Measuring Medium	B									Solid Powder
		05								5m
		10								10m
Measurement Range		15								15m
		20								20m
		XX								Other
Antenna Type			KE							Horn Mouth H227mm×Φ76mm 304SS
			KG							Horn Mouth H288mm×Φ96mm 304SS
			KL							Horn Mouth H620mm×Φ121mm 304SS
			KF							Horn Mouth H227mm×Φ76mm SS316L
			KH							Horn Mouth H288mm×Φ96mm SS316L
			KL							Horn Mouth H620mm×Φ121mm SS316L
Output and Power Supply				A2						Two-wire 4-20mA+HART
				SC						4-20mA+HART, 24VDC
				R2						RS485, 24VDC
				XX						Other
Thread Type				LG						G1 1/2 304SS
				LN						NPT1 1/2 304SS
				LH						G1 1/2 SS316L
				LP						NPT1 1/2 SS316L
				FE						HG/T20592 PN10/25 DN80 304SS
				HA						HG/T20592 PN10/25 DN80 Swivel 304SS
				FK						HG/T20592 PN10/25 DN80 SS316L
				HE						HG/T20592 PN10/25 DN80 Swivel SS316L

	FF			HG/T20592 PN10/16 DN100 304SS	
	HB			HG/T20592 PN10/16 DN100 Swivel 304SS	
	FL			HG/T20592 PN10/16 DN100 SS316L	
	HF			HG/T20592 PN10/16 DN100 Swivel SS316L	
	FG			HG/T20592 PN10/16 DN125 304SS	
	HC			HG/T20592 PN10/16 DN125 Swivel 304SS	
	FM			HG/T20592 PN10/16 DN125 SS316L	
	HG			HG/T20592 PN10/16 DN125 Swivel SS316L	
	XX			Other	
	High Temperature Resistance		TE		'-40-130℃
TH			'-40-230℃		
Electrical Interface, Housing Material, and Ingress Protection			WH	M20×1.5 Cable Gland, Aluminum Alloy, IP67	
Explosion-Proof Option				00	None
				E4	CNEX Ex db II C T6 Gb